


Wireless Changeover With Condensate Sensor

If a wireless controller is used an automatic changeover is not required. The controller knows whether the chiller **or** the boiler is ON. Therefore the Direct or Reverse action done by the controller will send a static position command to the actuator (ME8396).

The standard EnOcean actuator ME8396 from Spartan with a V246 valve will do the work.

The ME8396 will send feedback on position each time it reaches a new position.

If pan is wet "B", the ME8396 will close the valve and send a continuous position value of 00 at a period of 30 seconds.

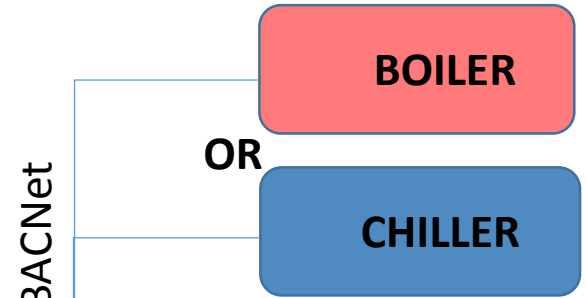

WT913G-NL
EEP: A5-10-03



V246-12F-EP3.0

